
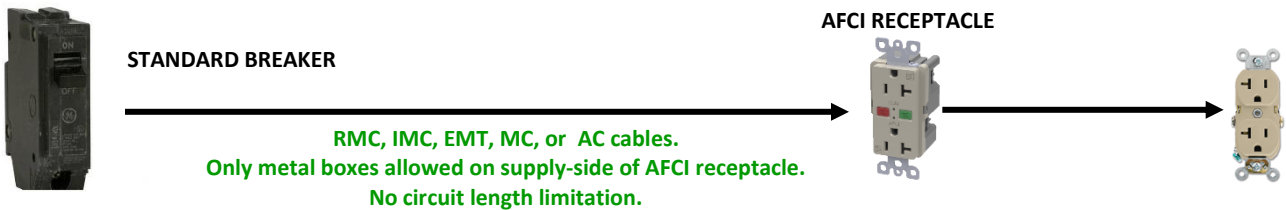
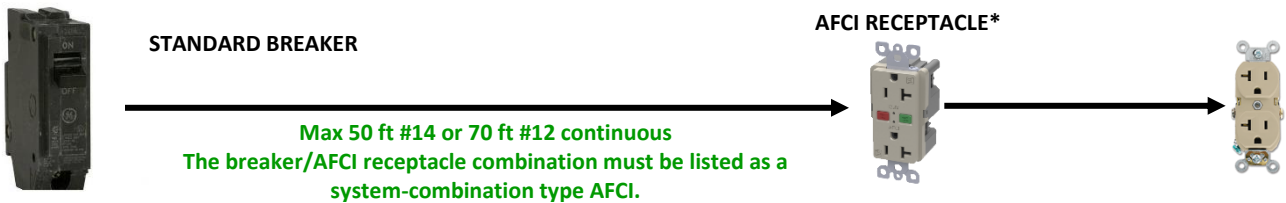
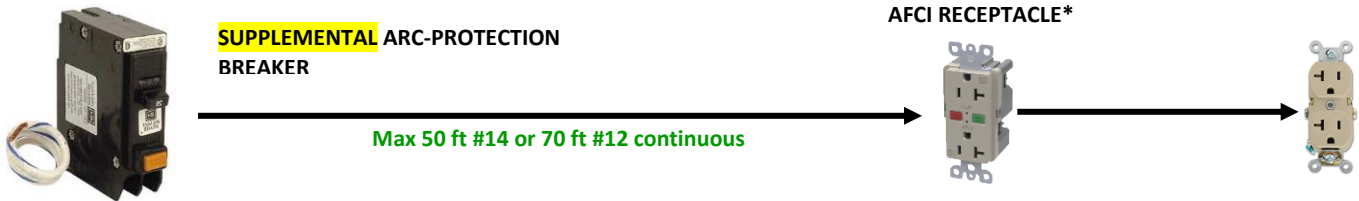


OPTIONS FOR INSTALLING AFCI PROTECTION BASED ON THE 2020 NEC, SECTION 210.12

A free resource provided by Electrical Training Resources LLC

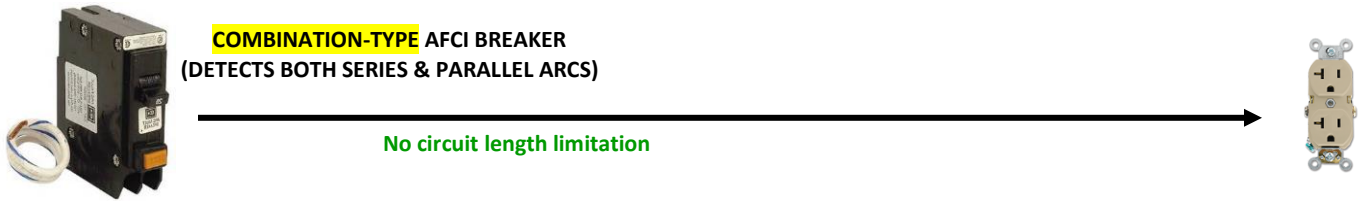

*An outlet/branch circuit type AFCI unit used in this scenario is required to be marked as the first outlet of the circuit. Circuit breakers and devices must be listed. Always read and comply with applicable electrical codes. This page is a summary only. NEC is a registered trademark of the National Fire Protection Association.